





**BULLOCK** MFG Pty Ltd.

## **Model 4900** Curtain Type Fire Damper

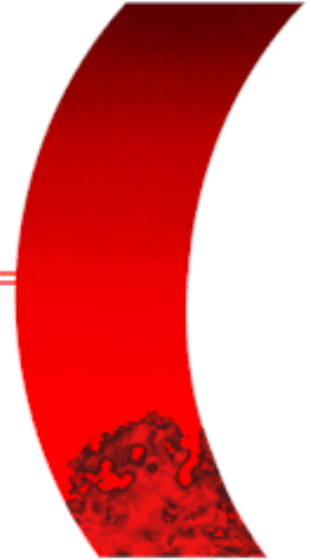

### **Product Description**

The Bullock Model 4900 Curtain Type Fire Dampers are installed to protect airconditioning and ventilation penetrations through fire rated walls or slabs. This Model Damper has been tested for 4 hours in a masonry wall and concrete slab and 2 hours in a steel stud plasterboard wall. Certified by the CSIRO for these ratings, this model complies with AS1668.1-1998 and AS1682.1-1990.

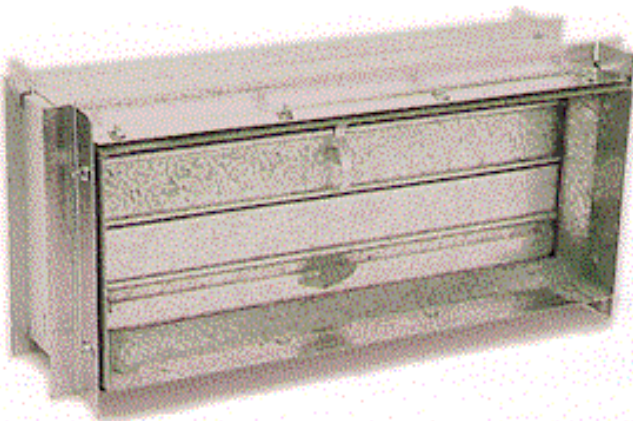

Model 4900 Curtain Type Fire Damper.



Model 4900 Spring-loaded curtain slab type fire damper.



Model 4900 Curtain type fire damper with optional TDF flanges




## Product Features

- Australian certified to AS1534.4 - 1997 by the C.S.I.R.O. in:
  - a) Masonry walls for 4 hours. Test #- FS-1472, FSV-0094
  - b) Concrete slabs for 4 hours. Test #- NF-08SV0343.
  - c) Steel Stud Plasterboard partition for 2 hours. Test #- FS-1495.
- All Galvanised Steel construction.
- Single (UL33 rated) fusible link.
- Readily available sizes:
  - wall type 100mm x 100mm up to 2400mm x 2400mm.
  - slab type 150mm x 150mm up to 750mm x 750 mm.
- Optional TDF/TDC type flanges available for 1 x leakage/breakaway point (Low melting point bolts to be used).
- Optional Metal Expansion Gap Seals available for a factory set 10mm expansion gap.

---

---


## Models Available

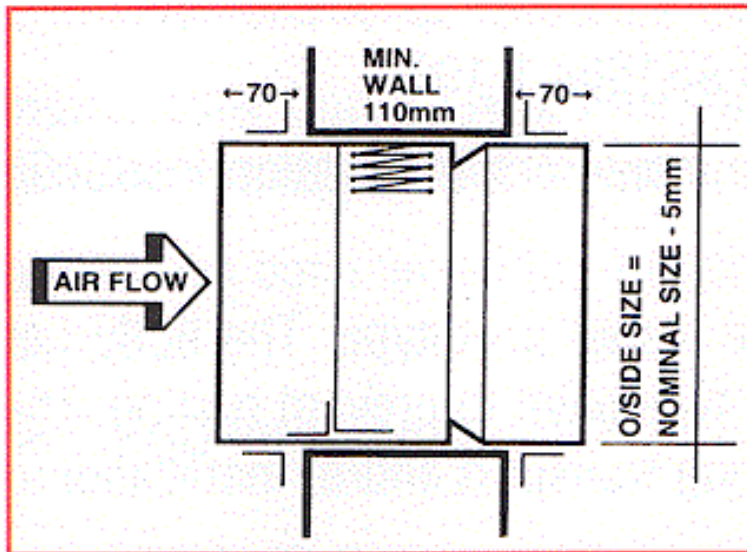

### Style D Duct to Duct

Order should read as follows:  
Width (blade length) x Height x Wall thickness. Minimum wall thickness 110mm.


Flange Sizes are as follows:  
Sizes under 1200 x 1200 = 30mm  
Sizes over 1200 x 1200 = 50mm

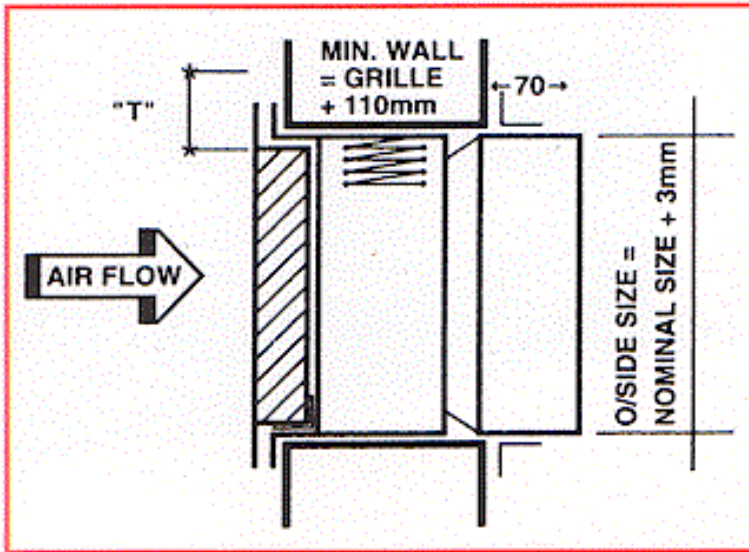

## Style GR Grille to Duct

Order should read as follows:  
Width (blade length) x Height x Wall thickness x Depth of recess for grille x Flange. Minimum wall thickness 130mm.

Minimum flange size "T"  
(max W or H / 100) + 10.  
Refer AS 1682.2-1990. Appendix C.

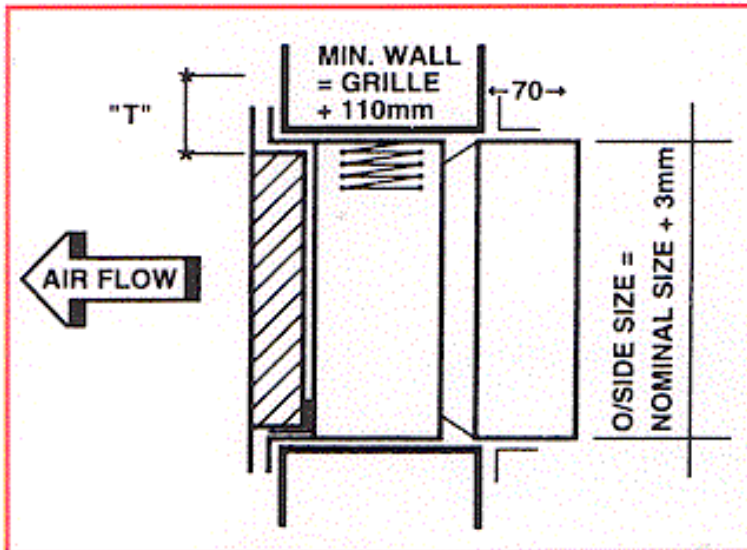

## Style GS Duct to Grille

Order should read as follows:  
Width (blade length) x Height x Wall thickness x Depth of recess for grille x Flange. Minimum wall thickness 110mm.

Minimum flange size "T"  
(max W or H / 100) + 10.  
Refer AS 1682.2-1990. Appendix C.

## Typical Specification

Openings in fire rated walls or slabs shall be protected by a Bullock Model 4900 curtain type fire damper or approved equivalent. Dampers shall be provided where shown on drawings and wherever required to meet local regulations and must comply with AS1682.1-1990 and AS1668.1-1998.

Dampers shall be installed in strict accordance with the manufacturer's installation instructions, to comply with the certificates of test furnished by the manufacturer.

The damper's construction must be in compliance with the tested prototype. The body being made with galvanised steel with any welds coated with cold zinc primer type paint to prevent rusting. The damper body must be strong and rigid to prevent

operational damage during transport and/or installation on site.

The dampers expansion gap must be constantly maintained with the use of Bullock Manufacturing's metal expansion gap sealing system, complying with AS1682.2-1990 or an approved equivalent. Fusible links are to operate at 68°C having a UL33 rating or AS1890 rating.

---

---

## Installation

Compliance with installation instructions is critical. Refer to separate wall/slab type installation instructions to suit your requirements. Please refer to installation Page.


## Maintenance

This model requires little maintenance once installed. Refer to AS1851.6-1997 for detailed servicing procedures.

## Metal Expansion Gap Seals

Optional metal expansion gap seals are also available on model 4900 Bullock Fire Damper. Metal seals allow the damper to be installed insitu with a 10mm controlled expansion gap (AS1682.2-1990). This means no installation or inspection costs plus the elimination of health hazardous fibers.  
(Aust Patent #-624288)

- No Installation costs.
- No hazardous fibers.
- Factory set 10mm gap.

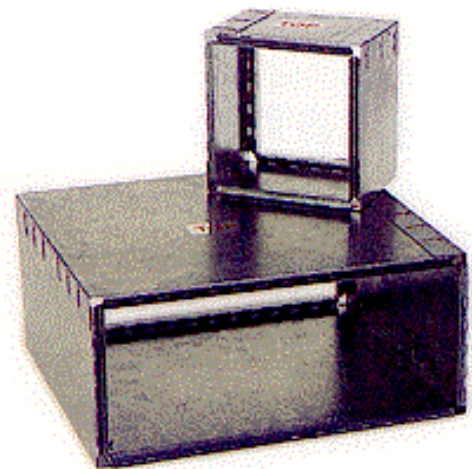

Specifications are subject to change without notice.

---

---

BULLOCK MFG P/L ~ 22 Pike St. Rydalmere. NSW 2116 Ph: (02)9684 1311 Fax: (02)9684 2250  
BULLOCK VIC P/L ~ 54 Tarnard Dr. Braeside. VIC 3195 Ph: (03)9587 5522 Fax: (03)9587 6622  
BULLOCK WA P/L ~ 34 Industry St. Malaga. WA 6062 Ph: (08)9248 1633 Fax: (08)9248 1733  
BULLOCK INDUSTRIES P/L ~ 26 Quindus St, Wacol. QLD 4076 Ph: (07) 3271 2088 Fax: (07)3271 1892  
BULLOCK SA P/L ~ U1 Commercial Crt. Dry Creek. SA 5094 Ph: (08) 8349 7088 Fax: (08)8349 7066

---

---

email: [bullmfg@bigpond.net.au](mailto:bullmfg@bigpond.net.au)

Copyright © 2004 Bullock Manufacturing Pty Limited. All Rights Reserved.