


TEST CERTIFICATE No.6 (J/N: 30S-25-0297)

AIRFLOW PERFORMANCE TESTS

SUPPLIED BY:	BULLOCK S.A. PTY. LTD.
TESTED BY:	VIPAC ENGINEERS & SCIENTISTS LTD
TEST DATE:	December 2025
CLIENT:	BULLOCK S.A. PTY. LTD.
UNIT:	4900 Curtain Blade Fire Damper
FACE SIZE:	1200mm x 1200mm

Air Flow Rate (L/s)	Static Pressure (Pa)
488	0.3
1027	1.3
1580	3.1
2082	5.3
2530	7.7
3027	11.3
3514	15.1
4006	19.5

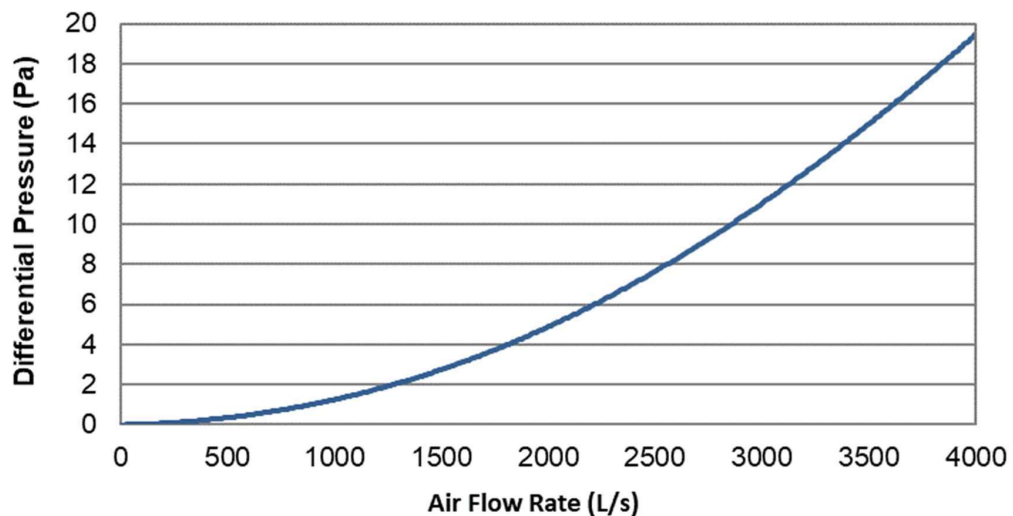

Simran

SIMRAN SIMRAN
PROJECT ENGINEER

Zarko Drinic

ZARKO DRINIC
AUTHORISED SIGNATORY