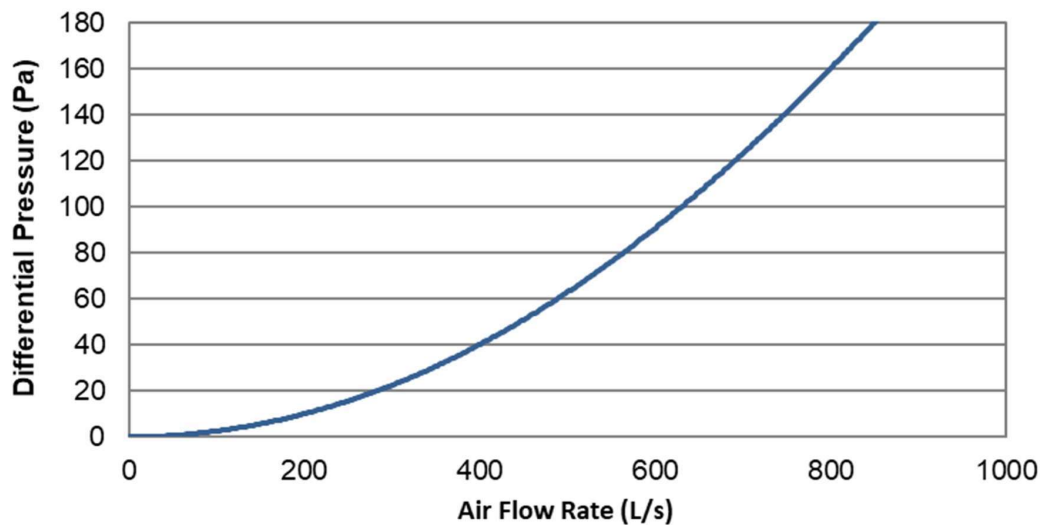



TEST CERTIFICATE No.4 (J/N: 30S-25-0297)

AIRFLOW PERFORMANCE TESTS

SUPPLIED BY:	BULLOCK S.A. PTY. LTD.
TESTED BY:	VIPAC ENGINEERS & SCIENTISTS LTD
TEST DATE:	December 2025
CLIENT:	BULLOCK S.A. PTY. LTD.
UNIT:	4900 Curtain Blade Fire Damper
FACE SIZE:	300mm x 300mm

Air Flow Rate (L/s)	Static Pressure (Pa)
146	5
291	21
429	47
527	69
621	97
714	128
785	154
823	169

SIMRAN SIMRAN
PROJECT ENGINEER



ZARKO DRINIC
AUTHORISED SIGNATORY