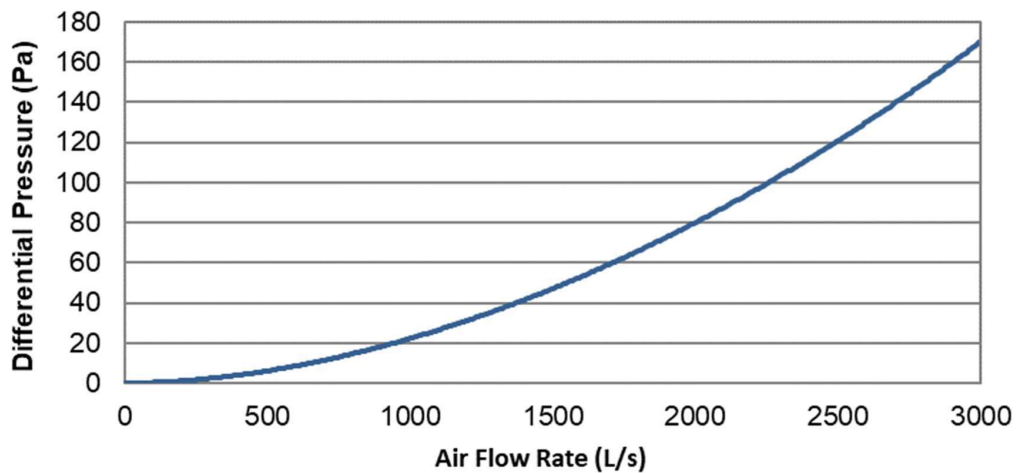



TEST CERTIFICATE No.5 (J/N: 30S-25-0297)

AIRFLOW PERFORMANCE TESTS

SUPPLIED BY:	BULLOCK S.A. PTY. LTD.
TESTED BY:	VIPAC ENGINEERS & SCIENTISTS LTD
TEST DATE:	December 2025
CLIENT:	BULLOCK S.A. PTY. LTD.
UNIT:	4900 Curtain Blade Fire Damper
FACE SIZE:	600mm x 600mm

Air Flow Rate (L/s)	Static Pressure (Pa)
417	4
565	8
866	17
1289	36
1717	61
2100	87
2583	129
3017	172

SIMRAN SIMRAN
PROJECT ENGINEER



ZARKO DRINIC
AUTHORISED SIGNATORY